


## Notice 04-001

It has come to the attention of the Foundation that some of the following FEBCO assemblies have been sold with a dimensional variation between the centerlines of the vertical inlet and vertical outlet. The assemblies affected include the following:

### Reduced Pressure Principle Assemblies

Model 825YA  $\frac{3}{4}$ ", 1", 1-1/2", 2"

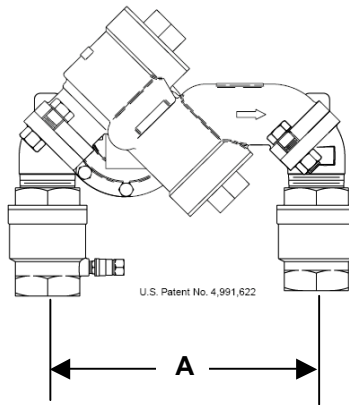

This variation in "A" has been found to be up to 1/8" for the  $\frac{3}{4}$ "-1" sizes, and 1/4" for the 1-1/2"-2" sizes. The variation in centerline dimension has not been found to affect the overall performance of the assembly, however, it has been reported as a significant problem when a change-out of the body occurs in the field. If the inlet and outlet piping is fixed, a body being replaced with a different end-to-end centerline dimension will not fit.

The subject assemblies affected with the longer centerline dimension have a serial number beginning with the letter "H" (i.e., Serial #Hxxxxx).

Should you have an assembly affected by this situation, please contact FEBCO at (559) 252-0791 for Foundation Approved replacement components.

6 August 2004